


INSTALLATION INSTRUCTIONS

1. ENSURE THE APERTURE IS CLEAN AND FREE OF DEBRIS. REMOVE DUST FROM SURFACES REQUIRING INSTALLATION.
2. FIX COLLAR AROUND BUTELINE PIPE AND SLIDE UP TO FACE OF PLASTERBOARD WALL. FIX COLLAR THROUGH LUGS INTO PLASTERBOARD WALL. ENSURE SUITABLE GALVANISED STEEL FIXINGS ARE USED WITH A MINIMUM 26MM EMBEDMENT AND ENSURE ALL FIXING POINTS ARE USED.
3. APPLY INTUMASTIC HP IN BETWEEN THE BUTELINE PIPE AND THE INTERNAL SIDE OF THE SL COLLAR.
4. REPEAT THE ABOVE TO THE OPPOSITE SIDE OF WALL.

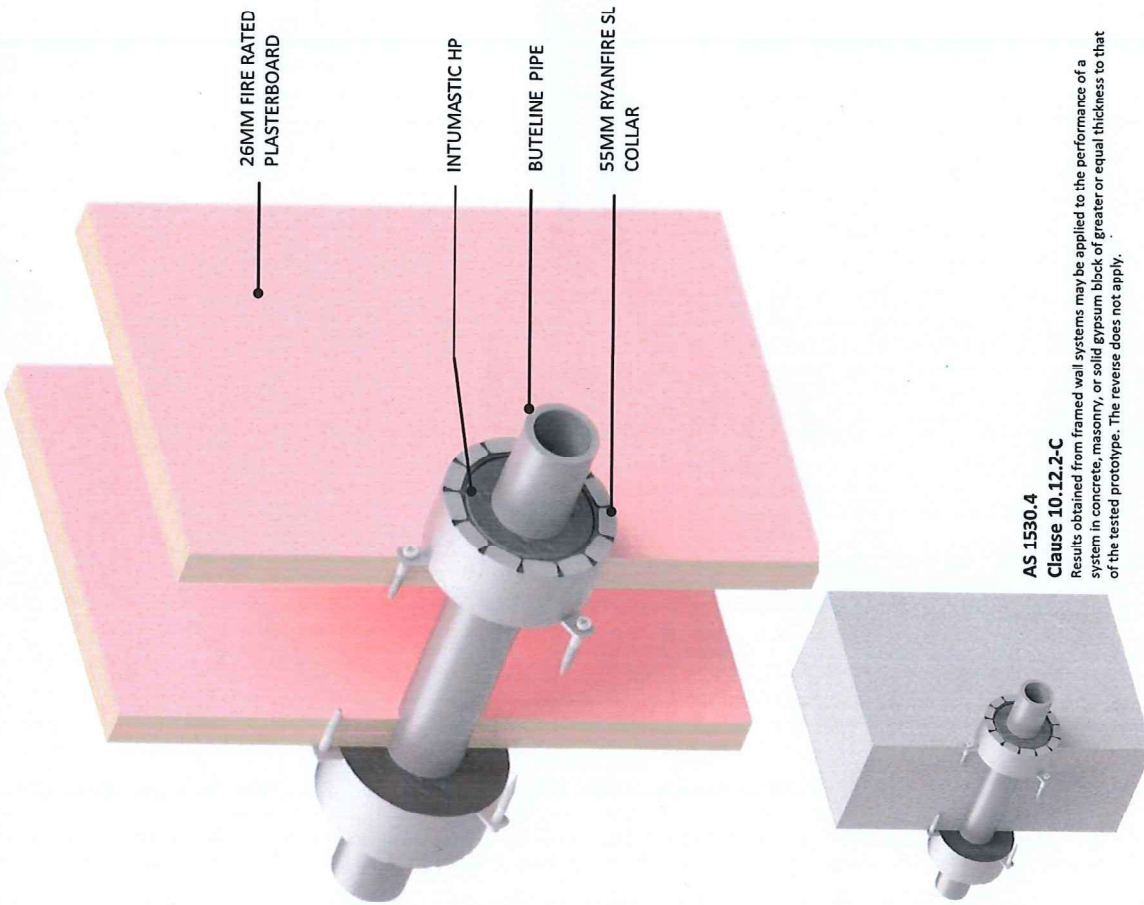

**AS 1530.4
Clause 10.12.2-C**

Results obtained from framed wall systems may be applied to the performance of a system in concrete, masonry, or solid gypsum block of greater or equal thickness to that of the tested prototype. The reverse does not apply.

Please note: Ryanfire Products Ltd owns and has copyright in these drawings. They are to be used only for the purpose for which they were intended and applied and are not to be sold, transferred or made available for use by a third party.
Any misuse of these drawings will result in legal proceedings.

All errors and omissions excepted - the information contained within this drawing is believed to be correct on the date of publication, and is based upon tested and certified solutions. The policy of Ryanfire Products Ltd is one of constant improvement. Installers must therefore ensure that they are following the latest published drawings, test evidence and instructions. Whilst Ryanfire Products Ltd will endeavour to keep its publications up to date, the accuracy of the information contained within this drawing may be affected by pertinent changes in the law or regulatory requirements and alterations or amendments to the specification of the manufactured products. Terms and conditions of sale apply.

RYANFIRE Technical Support: info@ryanfire.co.nz - Tel 09 443 0362

Notes

Products: RYANFIRE SL COLLAR
INTUMASTIC HP
Approvals: AS 1530.4/AS 4072.1
BK: 52
Ref: 51892000
ID: H

Construction: Plasterboard/Masonry fire wall.

Fire Resistance: 120 minutes.

Insulation: 120 minutes.

Services: Up to 22mm buteline pipe.

Web based drawings are for example only, fire performance of any system is dependant on, but not limited to size of opening, substrate, if penetrations are passing through, type, size and number. Please refer to Ryanfire technical department for detailed and specific fire performance information.



Client

Job Title

Drawing Title

**Buteline Pipe Through
Plasterboard Wall**

Scale

NTS

Date

July 2019

Sheet Size

A3

Drawn By

Drawing Number

V20.8

Rev

4.0